


Algorithms (200-299)a

HW STICKER	KW	CELLS	NOMINAL V	V4	Um	Ah	I4
V	A						

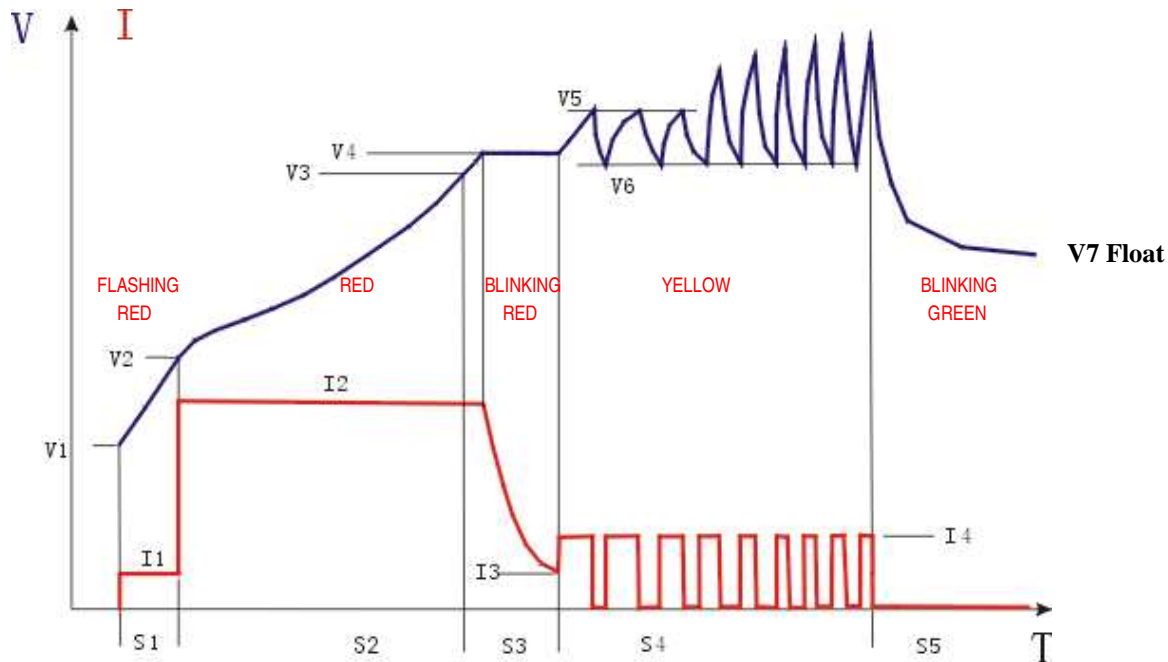

	Alg 200a	Alg 201a				Alg 212a
V1	1.00v	1.00v				1.00v
V2	2.00v	2.00v				2.00v
V3(10°C)	2.45v	2.45v				2.43v
V4(10°C)	2.47v	2.47v				2.45v
V5(10°C)	2.66v	2.66v				2.63v
V6(10°C)	2.41v	2.41v				2.40v
V7(10°C)	2.31v	2.31v				2.31v
I1	AH/40	AH/40				AH/40
I2	AH /1	AH /1				AH /1
I3	AH /80	AH /160				AH /33
I4	AH /80	AH /80				AH /33
Tmin_pulse(S)	30(S)	30(S)				20(S)
T_S1_max	18 h	18 h				18 h
T_S2_max	18 h	18 h				18 h
AH_S2_max	AH*2.0	AH*2.0				AH*2.0
T_S3_max	4h	4h				4h
AH_S3_max	AH*0.3	AH*0.3				AH*0.3
T_S4_max	6h	6h				6h
S4_overcharge	12%	12%				12%
TC(V/°C)	-0.004v	-0.004v				-0.004v
Um	2.67v	2.67v				2.67v

115 VAC POWER:		230 VAC POWER:	
-----------------------	--	-----------------------	--